


Figure A-2: **2006** Acetic Acid Absorption Test Results

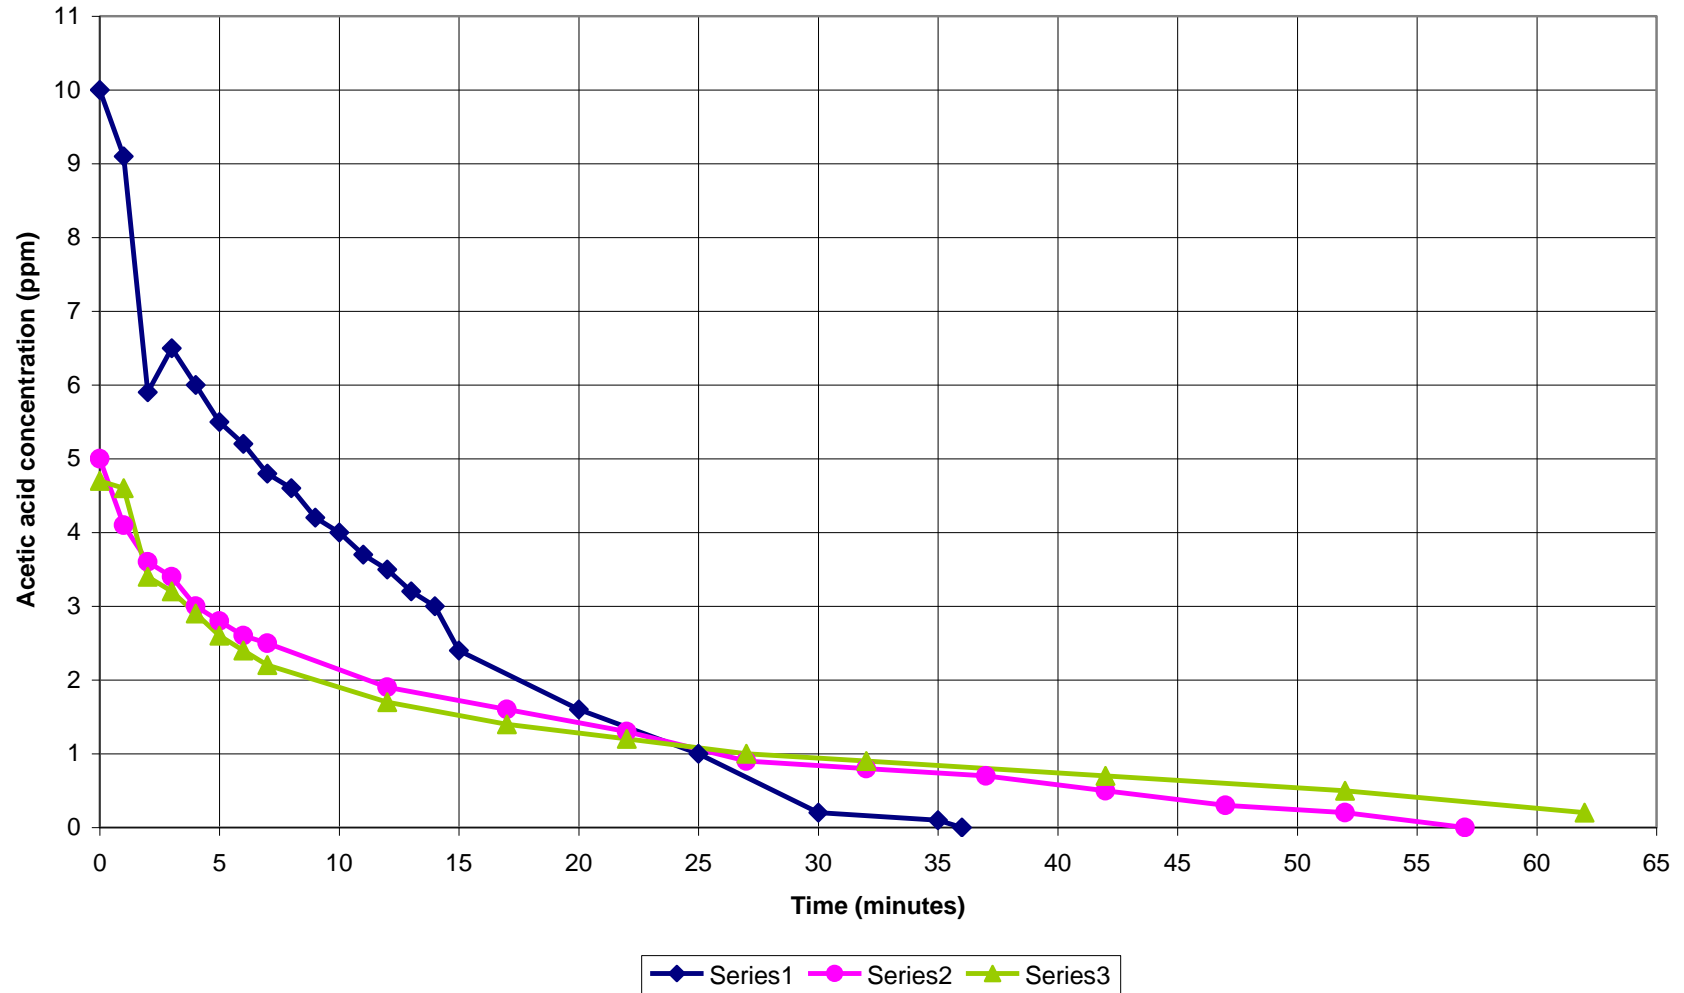

Series 1 -- 100% Absorbed    Series 2 -- 100% Absorbed    Series 3 -- 98.6% Absorbed